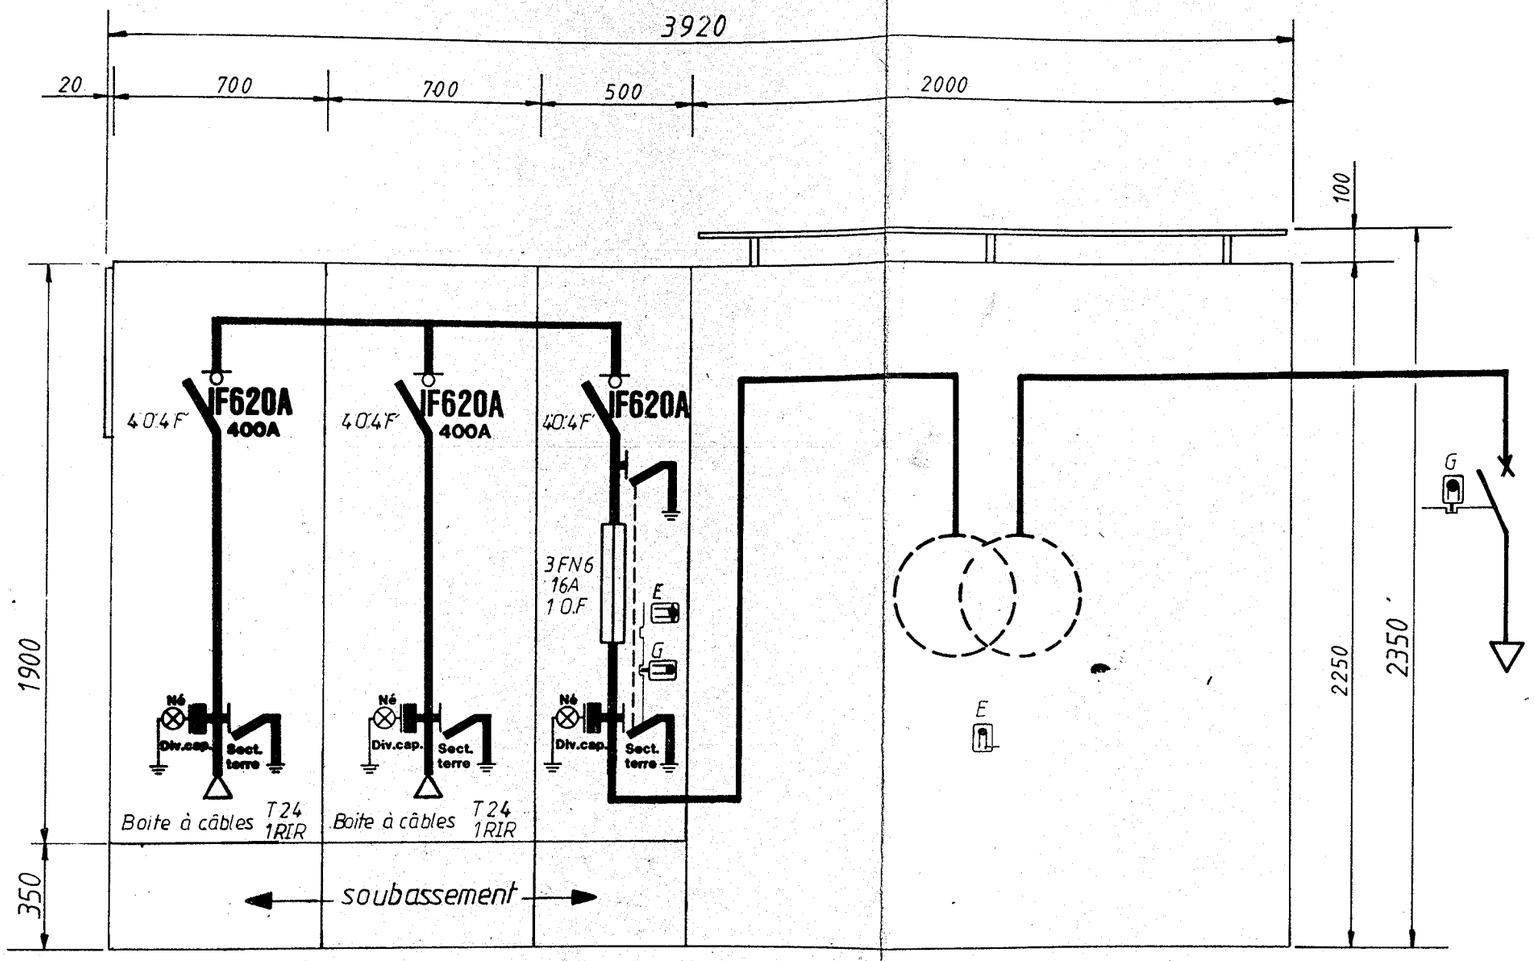

NOTA : Verrouillage de boucle suivant 1.087.030

E : EM 05500
G : EM 23300

REPERE	01	02	03	04	05
TYPE	F 921	F 921	F522	N 1756	N 667C
DESIGNATION	ARRIVEE Interrupteur	ARRIVEE Interrupteur	Protection Transfo	TRANSFORMATEUR	
SCHEMA	822410/101_102	822410/101_102	822411/ 101 102 105		

Le présent document est la propriété exclusive d'ALSTHOM ATLANTIQUE. Remis à titre confidentiel, il ne peut être communiqué à des tiers, ni utilisé ou reproduit qu'en stricte conformité d'autorisations expresses préalables.
This document is the sole property of "ALSTHOM ATLANTIQUE". It is submitted on a confidential basis and may not be passed on the third parties, used or reproduced except in exact accordance with prior express permission.

SANTA ANNA

UNIFILAIRE

ALSTHOM ATLANTIQUE DELLE-ALSTHOM appareillage moyenne tension

FOLIO 2 / 9

ECHELLE SCALE

N° CDE ORDER N° 5E/61258/F01

Qualité AQ

A3 DAM 2085 A

NUMERO NUMBER 465 887 / 100

MACON

REF. CLIENT CUSTOMER REF.

N° CLIENT CUSTOMER Nr

MODIFICATION CHANGE	DATE DATE	N° MOD. CHANGEN°	IND. REP.	NOM/NAME	DATE/DATE
	31/01/86.	53805	B		
	05.12	53643	A	A. B.	85.12

ETABLI PREPARED BY

VERIFIE CHECKED BY